

IECC Compliance Guide to Windows Used for Replacement and Remodeling in Virginia

Designed to Comply with the IECC Requirements for Existing Single-Family Residential Buildings in Virginia

Code: 2000 International Energy Conservation Code (IECC)

First Edition

How to Use This Guide

This guide is designed to meet the requirements of the IECC as it relates to Virginia with respect to replacement windows and remodeling. Each county is assigned to one of two packages (A or B), which vary according to the different climate zones in Virginia.

Step-by-Step Instructions

1. Use the color-coded map to locate the county in which construction is taking place and find the package (A or B) associated with that county.
2. Use the "Table of IECC Requirements for Windows Used for Replacement or Remodeling in Virginia" (on the back of this sheet) to choose proper windows based upon the package selected in Step 1, above.
3. Replace the old windows or complete remodeling with windows that have U-factors less than or equal to the value for the selected path and meet the code's maximum air leakage requirements.


Example: If you are replacing windows in a home in Loudoun County, found in Package B, you will comply with the IECC as it relates to Virginia if your replacement windows have a maximum U-factor of 0.40 and air leakage less than 0.3 cfm/sq.ft.

Obtaining the IECC

The IECC is published by the International Code Council (ICC). For additional details on the IECC or to purchase a copy, contact the ICC or visit its website at www.iccsafe.org.

Limitations

This guide is an energy code (IECC based) replacement window and remodeling compliance aid for Virginia and does not provide a guarantee for meeting the state energy code. The guide has not been customized to reflect any state-specific amendments to the IECC that Virginia may adopt or has adopted. The window requirements in this guide, when used for remodeling, also depend upon the energy performance values of other envelope components in the home, i.e., insulation R-values in ceilings, walls, etc., not identified in this guide. For those values, refer to Tables in Chapter 5 of the IECC. For additional details on Virginia's energy code, contact your local building code official.

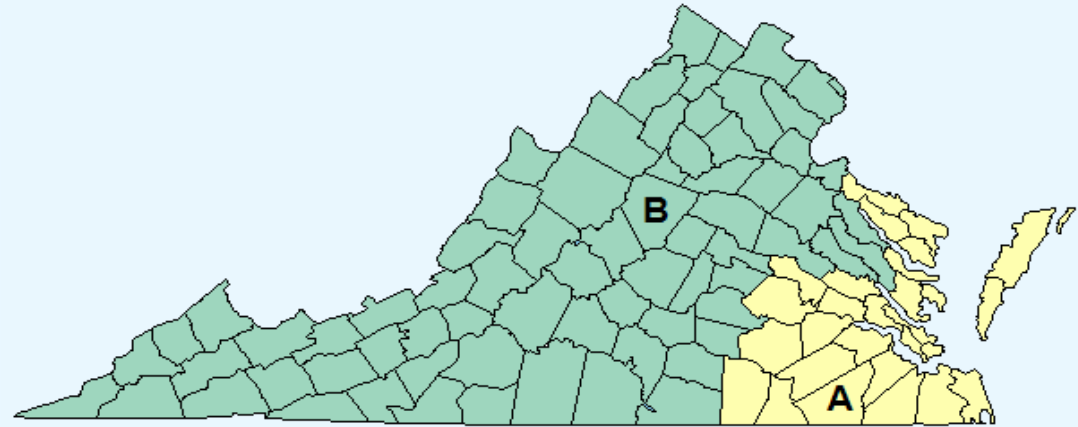

Virginia Counties by Package

A	3,500 - 3,999 HDD				
Accomack	Gloucester	Lancaster	Northampton	Surry	
Brunswick	Greensville	Mathews	Northumberland	Sussex	
Charles City	Henrico	Middlesex	Prince George	Westmoreland	
Chesterfield	Isle Of Wight	Nansemond	Richmond	York	
Dinwiddie	James City	New Kent	Southampton		

B	4,000 - 5,999 HDD				
Albemarle	Carroll	Goochland	Mecklenburg	Rockingham	
Alleghany	Charlotte	Grayson	Montgomery	Russell	
Amelia	Clarke	Greene	Nelson	Scott	
Amherst	Craig	Halifax	Nottoway	Shenandoah	
Appomattox	Culpeper	Hanover	Orange	Smyth	
Arlington	Cumberland	Henry	Page	Spotsylvania	
Augusta	Dickenson	Highland	Patrick	Stafford	
Bath	Essex	King and Queen	Pittsylvania	Tazewell	
Bedford	Fairfax	King George	Powhatan	Warren	
Bland	Fauquier	King William	Prince Edward	Washington	
Botetourt	Floyd	Lee	Prince William	Wise	
Buchanan	Fluvanna	Loudoun	Pulaski	Wythe	
Buckingham	Franklin	Louisa	Rappahannock		
Campbell	Frederick	Lunenburg	Roanoke		
Caroline	Giles	Madison	Rockbridge		

HDD = Heating Degree Days

Table of IECC Requirements for Windows Used for Replacement or Remodeling in Virginia

Simplified Prescriptive Requirements for Compliance with the IECC for Window Replacement and Remodeling in Virginia

Package	Maximum Window U-factor
A	0.50
B	0.40

For more information on energy efficient windows, go to the Efficient Windows Collaborative website at:



www.efficientwindows.org

Look for the NFRC Label!
The most important value to look for is the U-factor.

NOTES:

1. This table of requirements for windows used for replacement or remodeling is based upon the International Energy Conservation Code (IECC) and does not reflect any state-specific amendments to the IECC. The IECC has requirements, in addition to those shown, for additions to existing homes.
2. Source of Requirements: 2000 IECC, Ch. 5, Section 502.1.5, 502.2.5, and Table 502.2.5.
3. This table applies to single-family, residential construction.
4. Remodeling projects permitted to use this guide are additions, other than sunroom additions, less than 500 square feet of conditioned floor area. The total area of fenestration products shall not exceed 40% of the gross wall and roof area of the addition.
5. Alternate compliance approaches must be used for additions greater than 500 square feet and/or 40% fenestration area.
6. This guide may also be used for conditioned sunroom additions that maintain thermal isolation; are not used as kitchens or sleeping rooms; and are served by a separate heating or cooling system or are thermostatically controlled as a separate zone of the existing system.
7. The maximum U-factor for a replacement skylight for Packages A - B (above 2,000 heating degree days) shall be 0.60.
8. "Window" refers to any translucent or transparent material (i.e., glazing) in exterior openings of buildings, including skylights, glass doors, the glass areas of opaque doors, and glass block, along with the accompanying sashes, frames, etc.
9. Replacement refers to instances in which an entire new window unit is installed, including insert or pocket-type window replacements, which are commonly installed over an existing window frame.
10. U-factor is a number, generally between 0.2 and 1.20, that indicates the rate of heat loss (or gain) through a window. A lower U-factor demonstrates a greater resistance to heat loss or gain, i.e., better insulating value, of the window. This number is important for winter comfort.
11. Window U-factor must be determined from a National Fenestration Rating Council (NFRC) label on the product (see sample label below), or from a limited table of product "default" values in the IECC.
12. The code requires that windows be labeled in a manner to determine that they meet the IECC's air infiltration requirements; specifically, equal to or better than 0.30 cfm per square foot of window area (swinging glass doors below 0.50 cfm) as determined in accordance with AAMA/WDMA 101/I.S.2 (ASTM E 283).

	World's Best Window Co. Millennium 2000+ Vinyl-Clad Wood Frame Double Glazing • Argon Fill • Low E Product Type: Vertical Slider
ENERGY PERFORMANCE RATINGS	
U-Factor (U.S./I-P) 0.35	Solar Heat Gain Coefficient 0.32
ADDITIONAL PERFORMANCE RATINGS	
Visible Transmittance 0.51	Air Leakage (U.S./I-P) 0.2
<small>Manufacturer stipulates that these ratings conform to applicable NFRC procedures for determining whole product performance. NFRC ratings are determined for a fixed set of environmental conditions and a specific product size. Consult manufacturer's literature for other product performance information. www.nfrc.org</small>	

13. The labeled product U-factor value should also be used in calculation procedures to properly size the home's HVAC equipment. The IECC requires the use of a computational procedure like ACCA Manual J to size equipment. Properly sized equipment operates more efficiently and effectively and will save money up front because consumers can avoid paying extra for oversized equipment.